





PLANIMETRIA PUNTI DI RILIEVO DEI RILIEVI FONOMETRICI

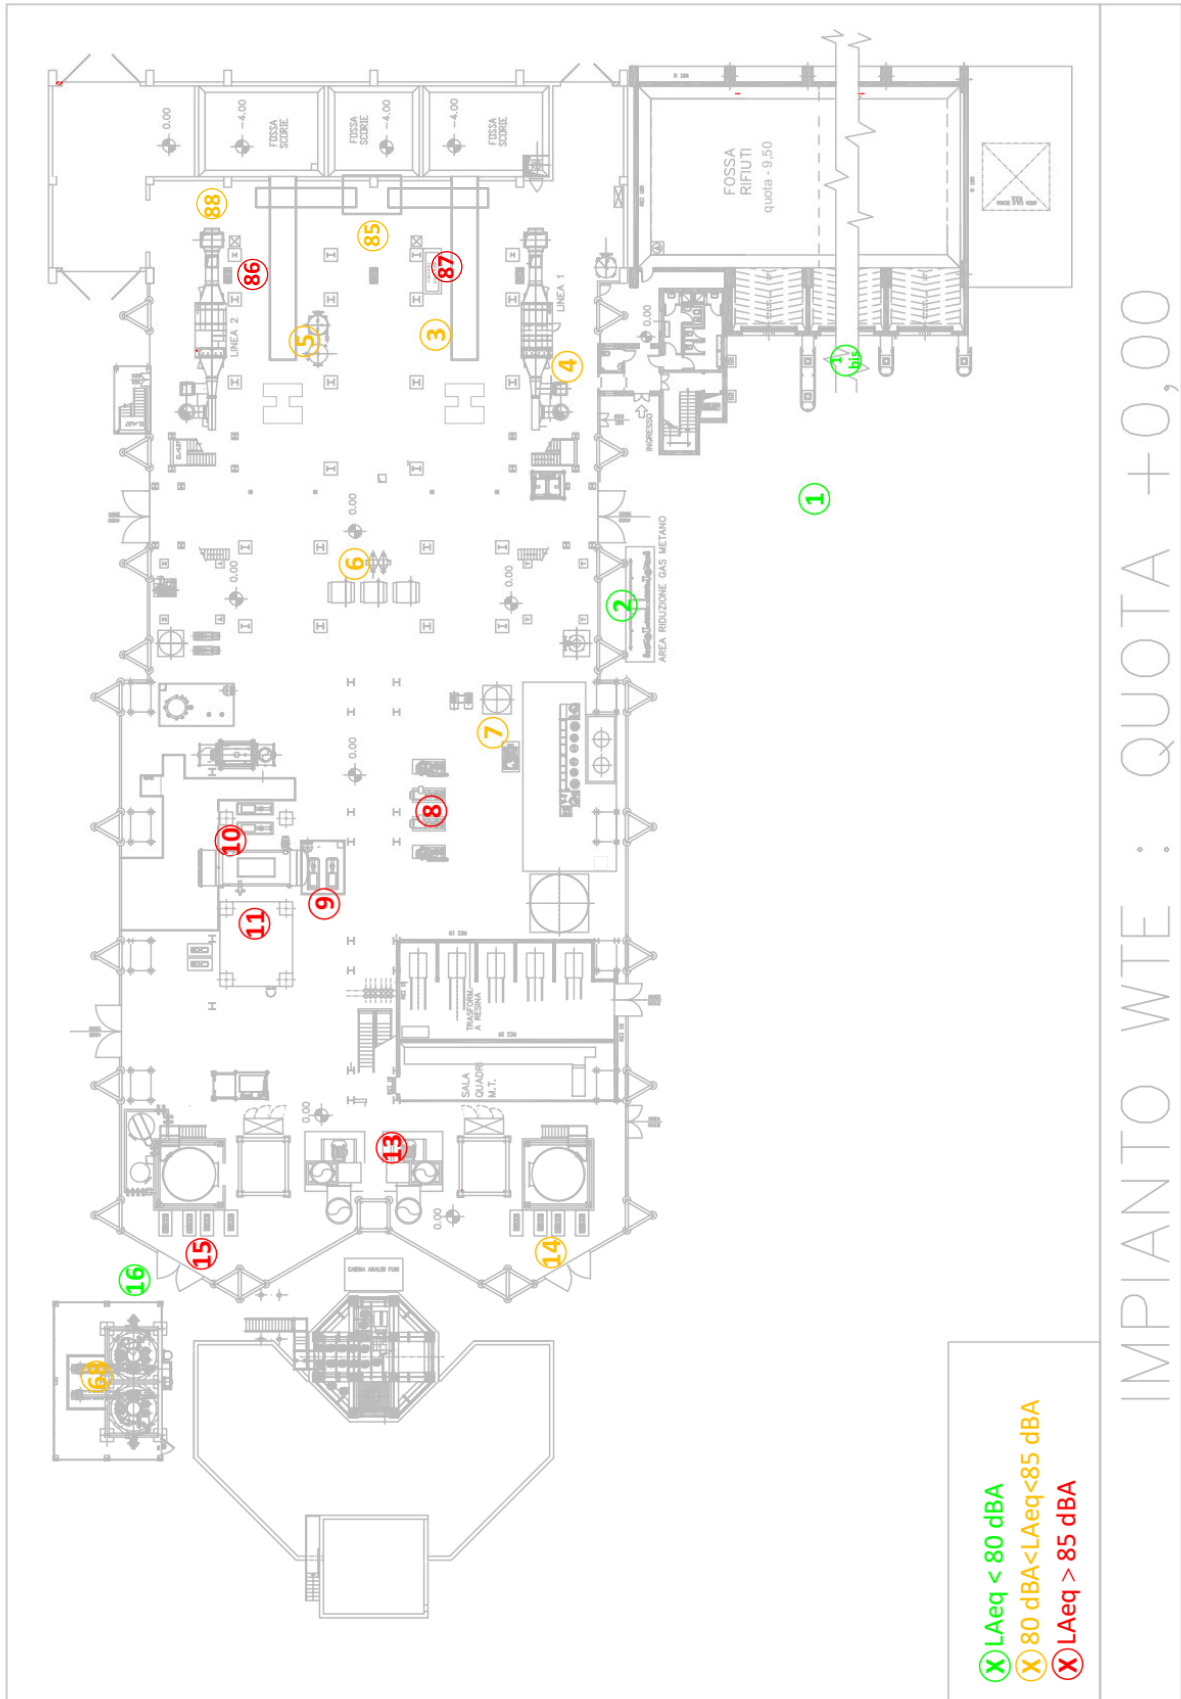


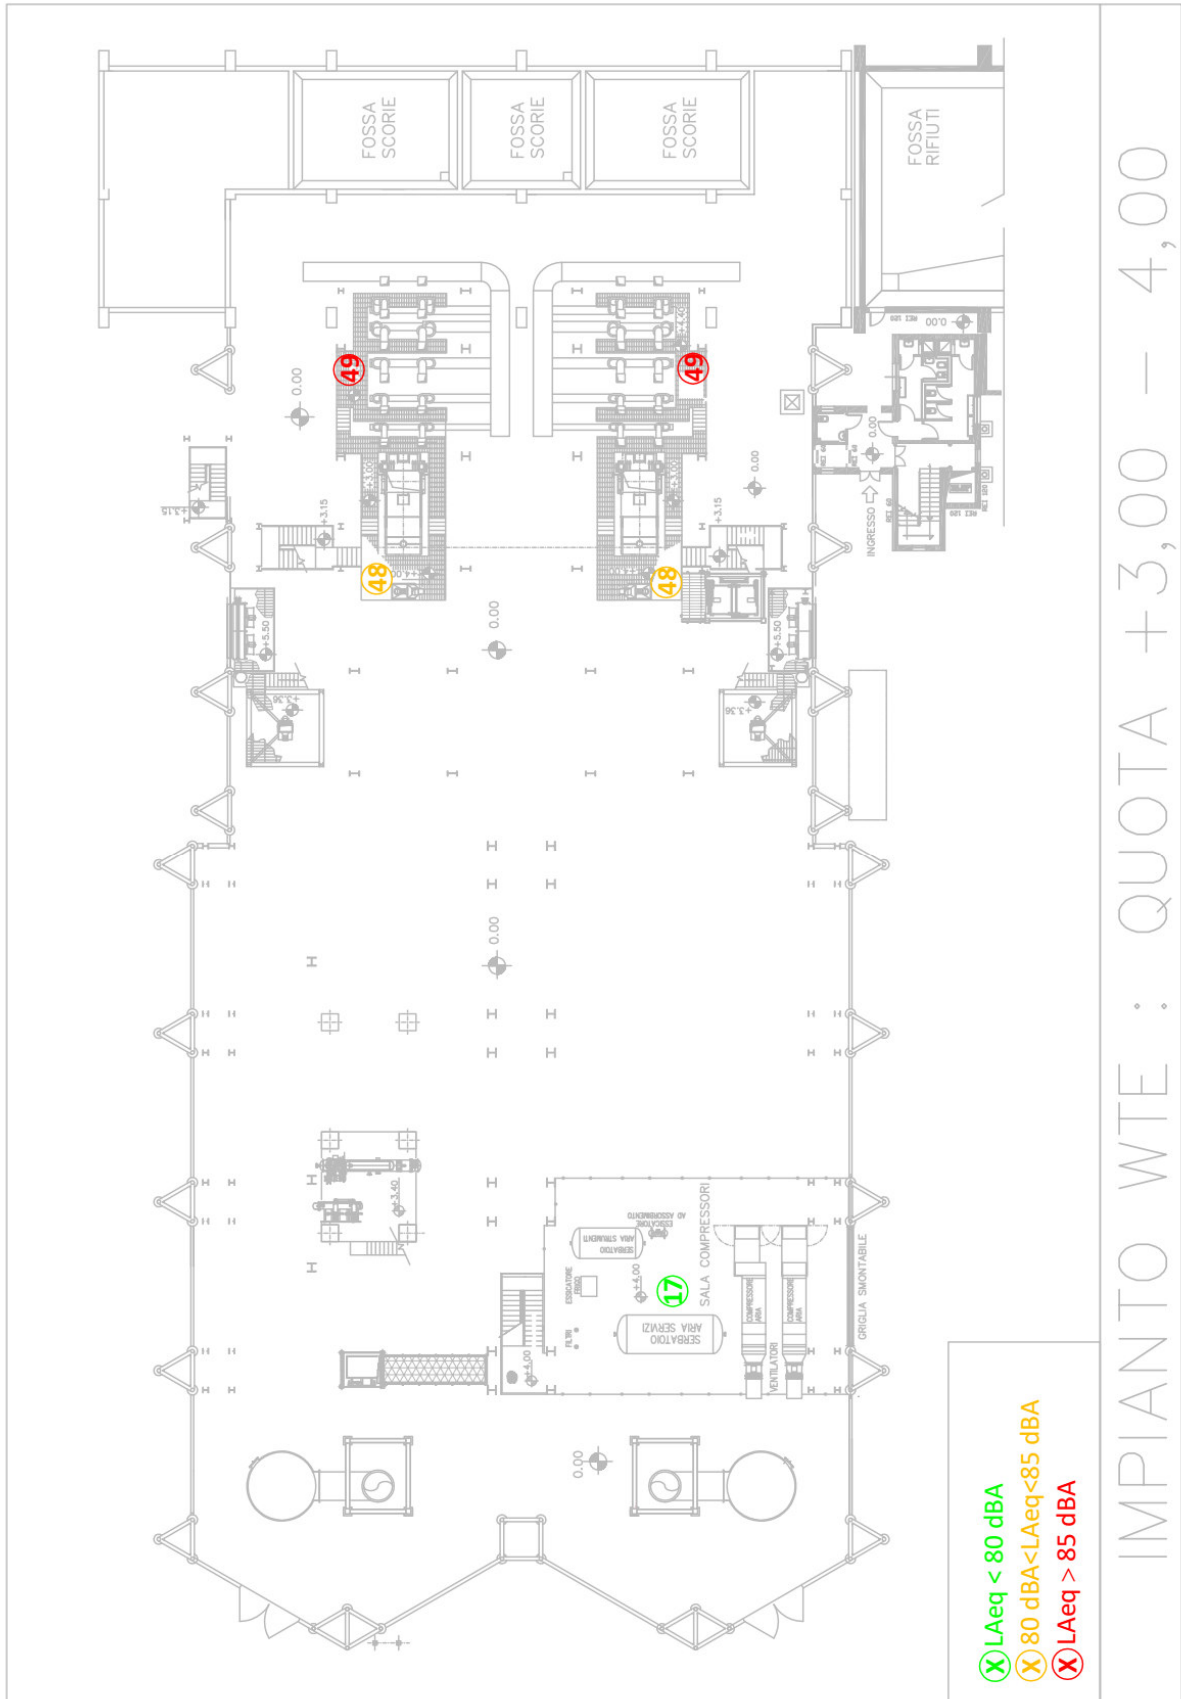

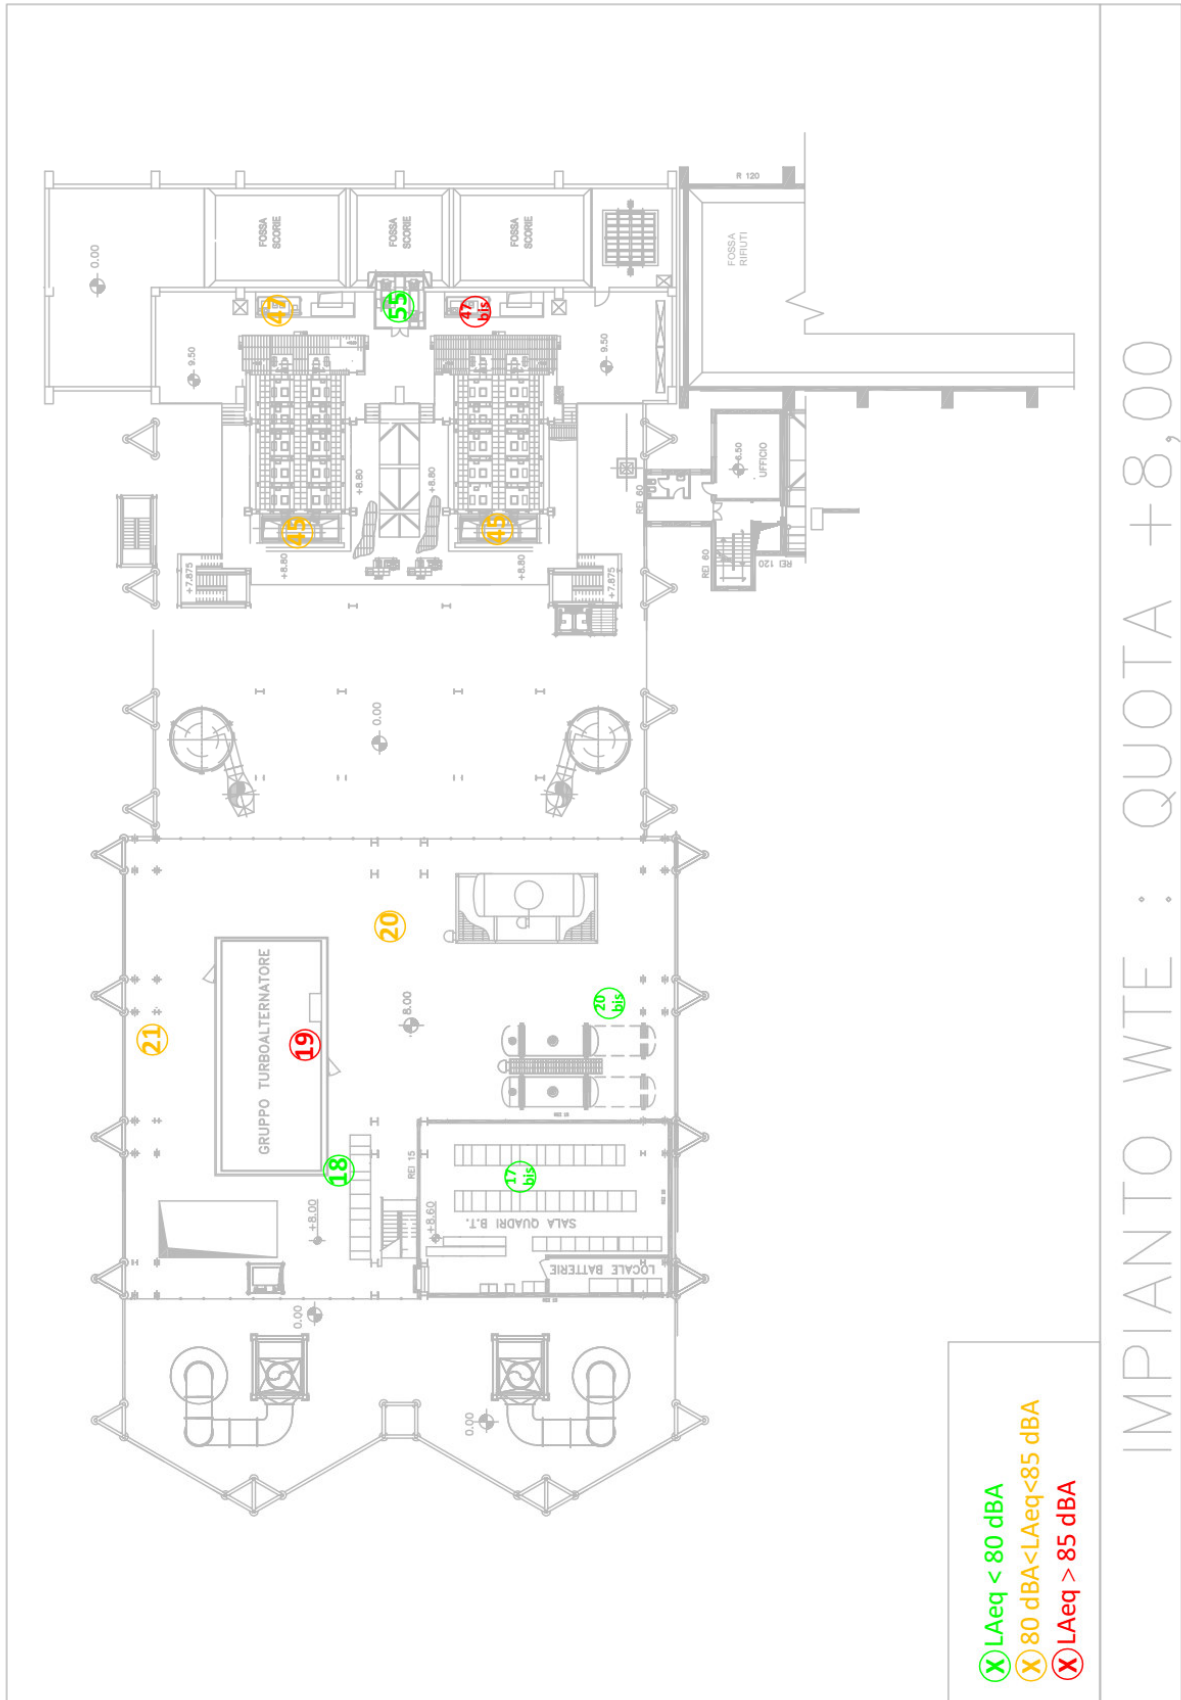

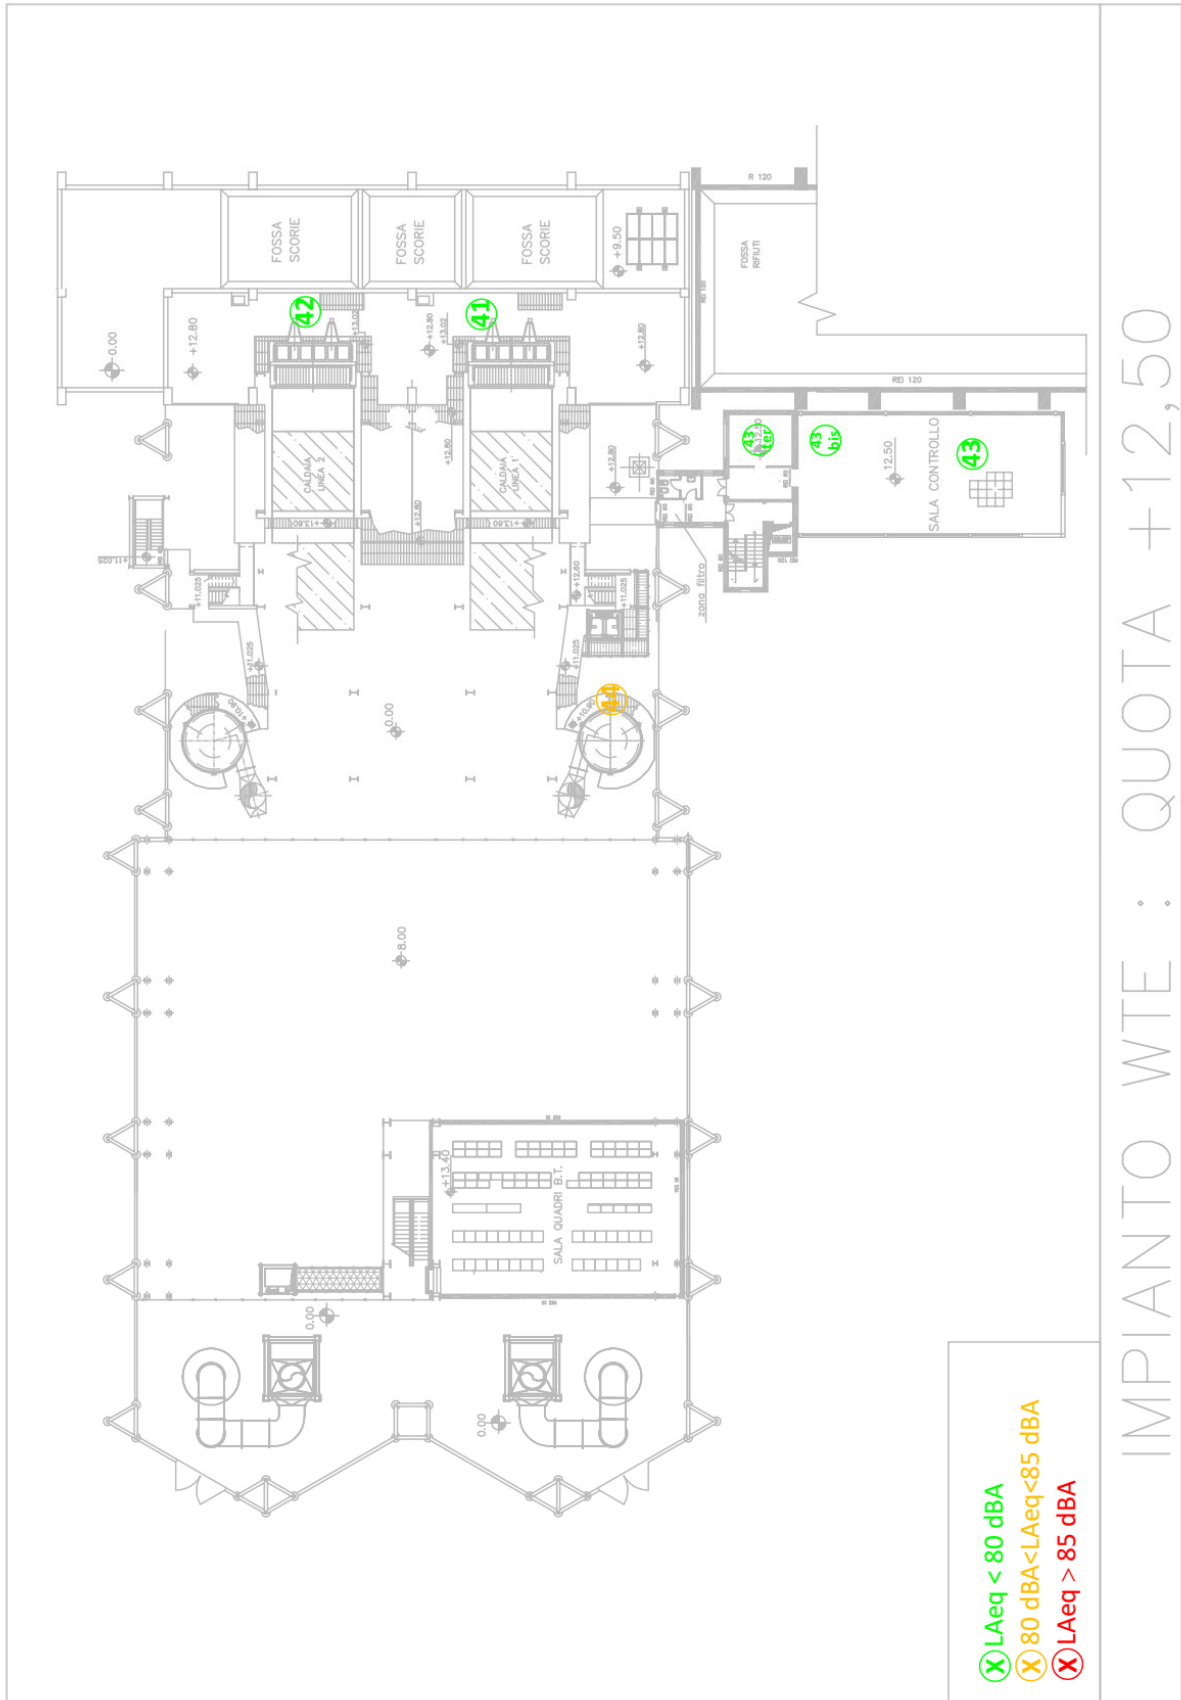



- ⊗ LAeq < 80 dBA
- ⊗ 80 dBA < LAeq < 85 dBA
- ⊗ LAeq > 85 dBA

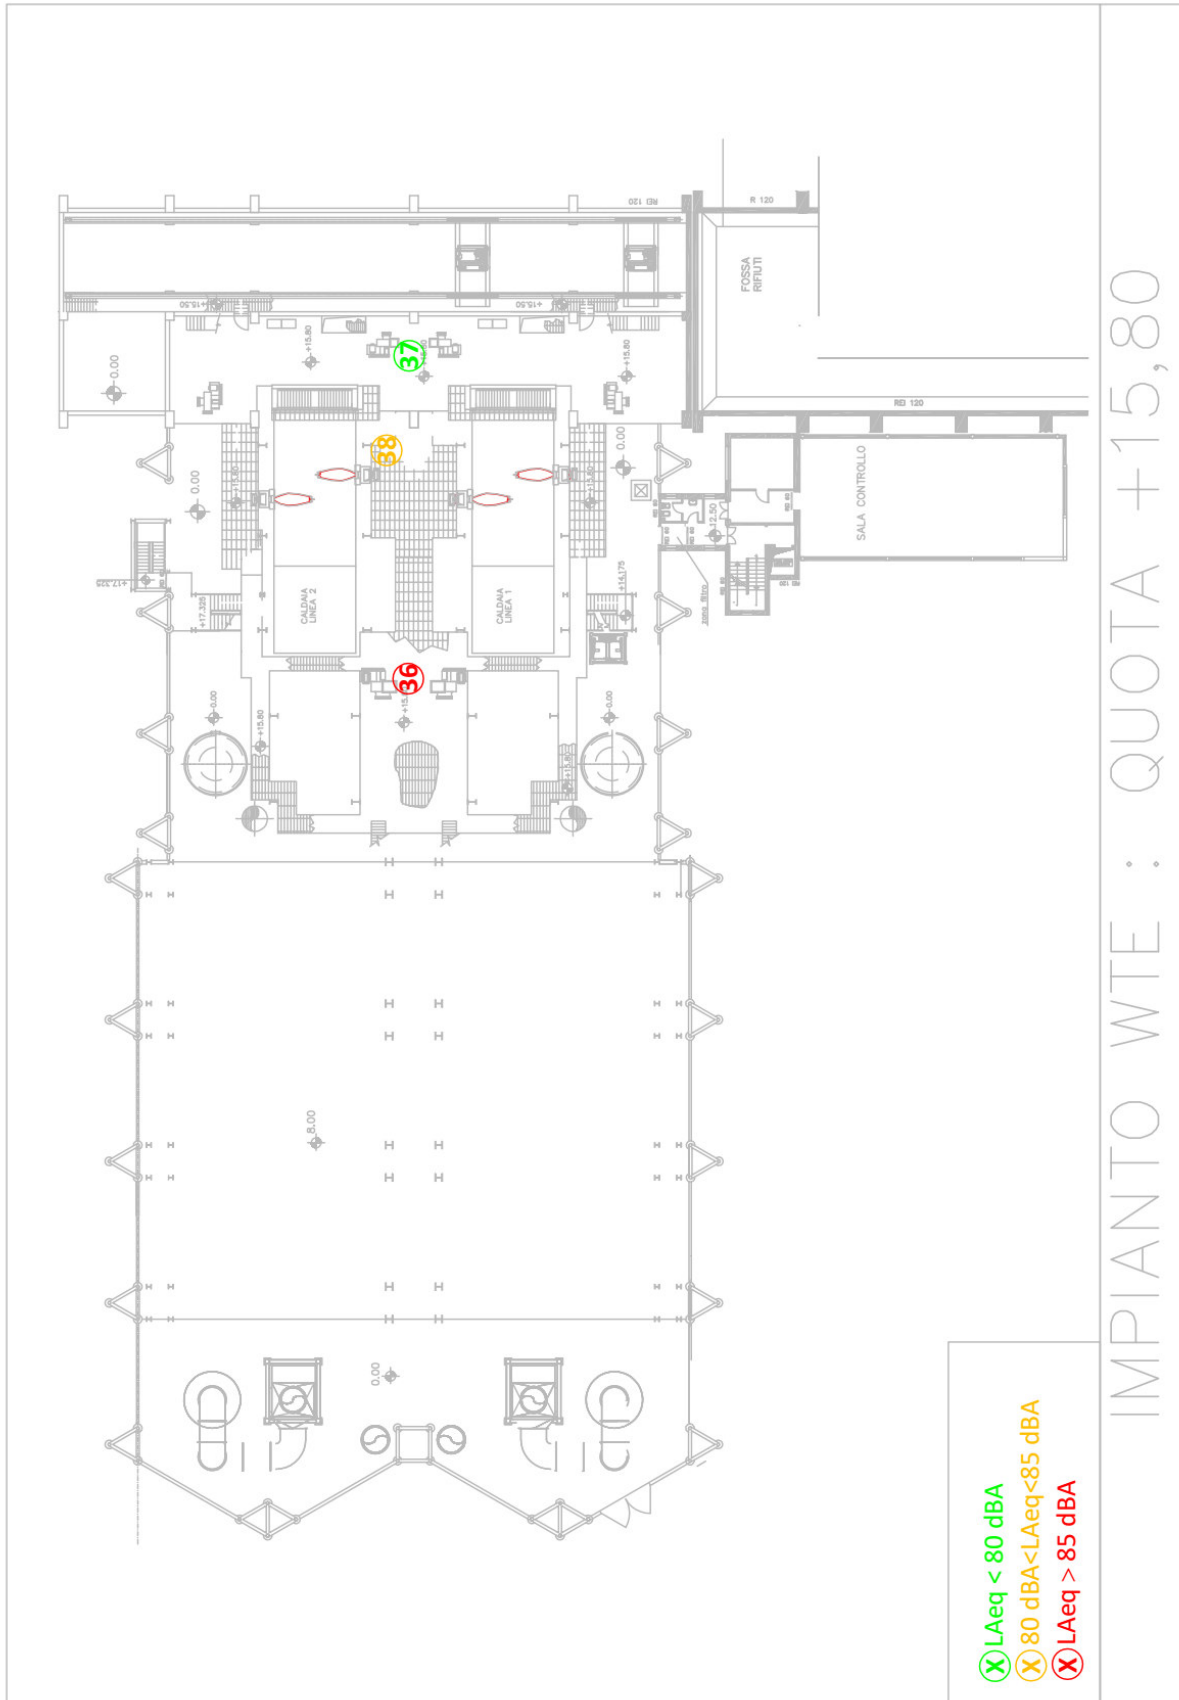

- ⊗ LAeq < 80 dBA
- ⊗ 80 dBA < LAeq < 85 dBA
- ⊗ LAeq > 85 dBA


IMPIANTO WTE : QUOTA +15,80

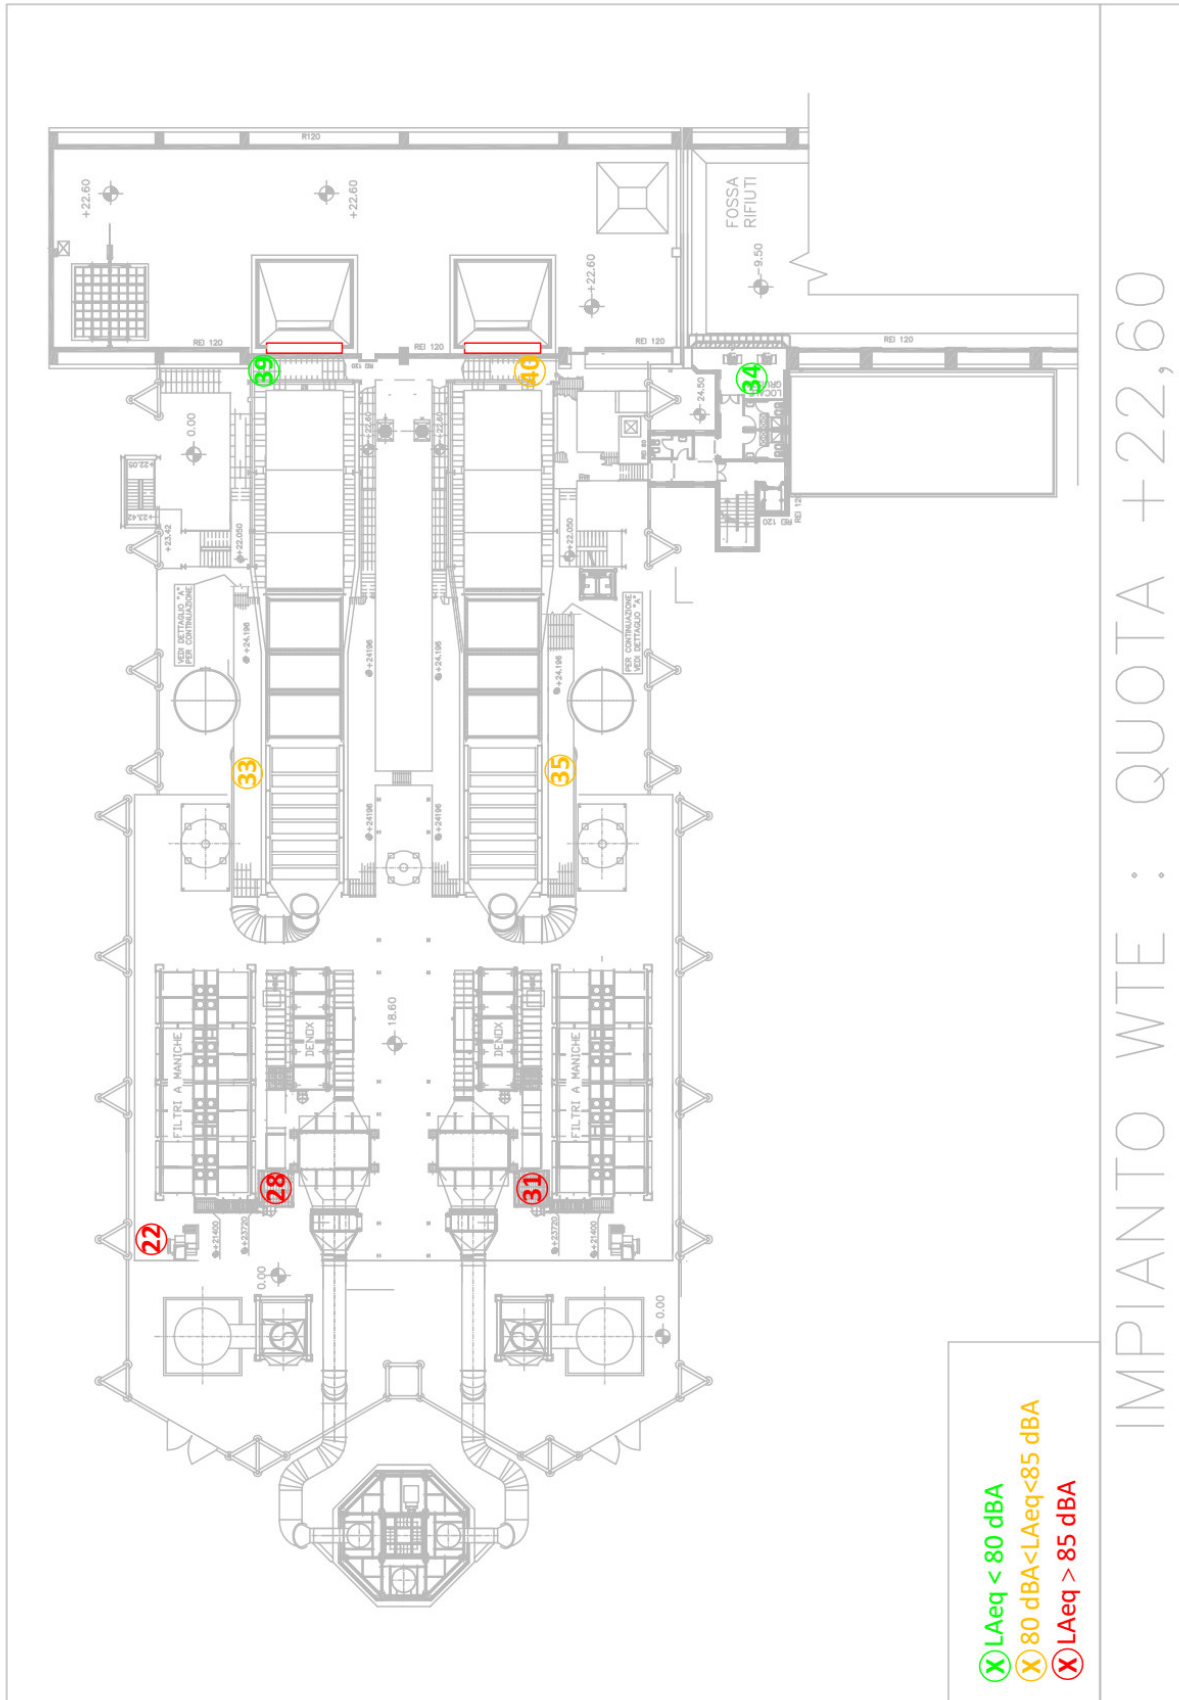

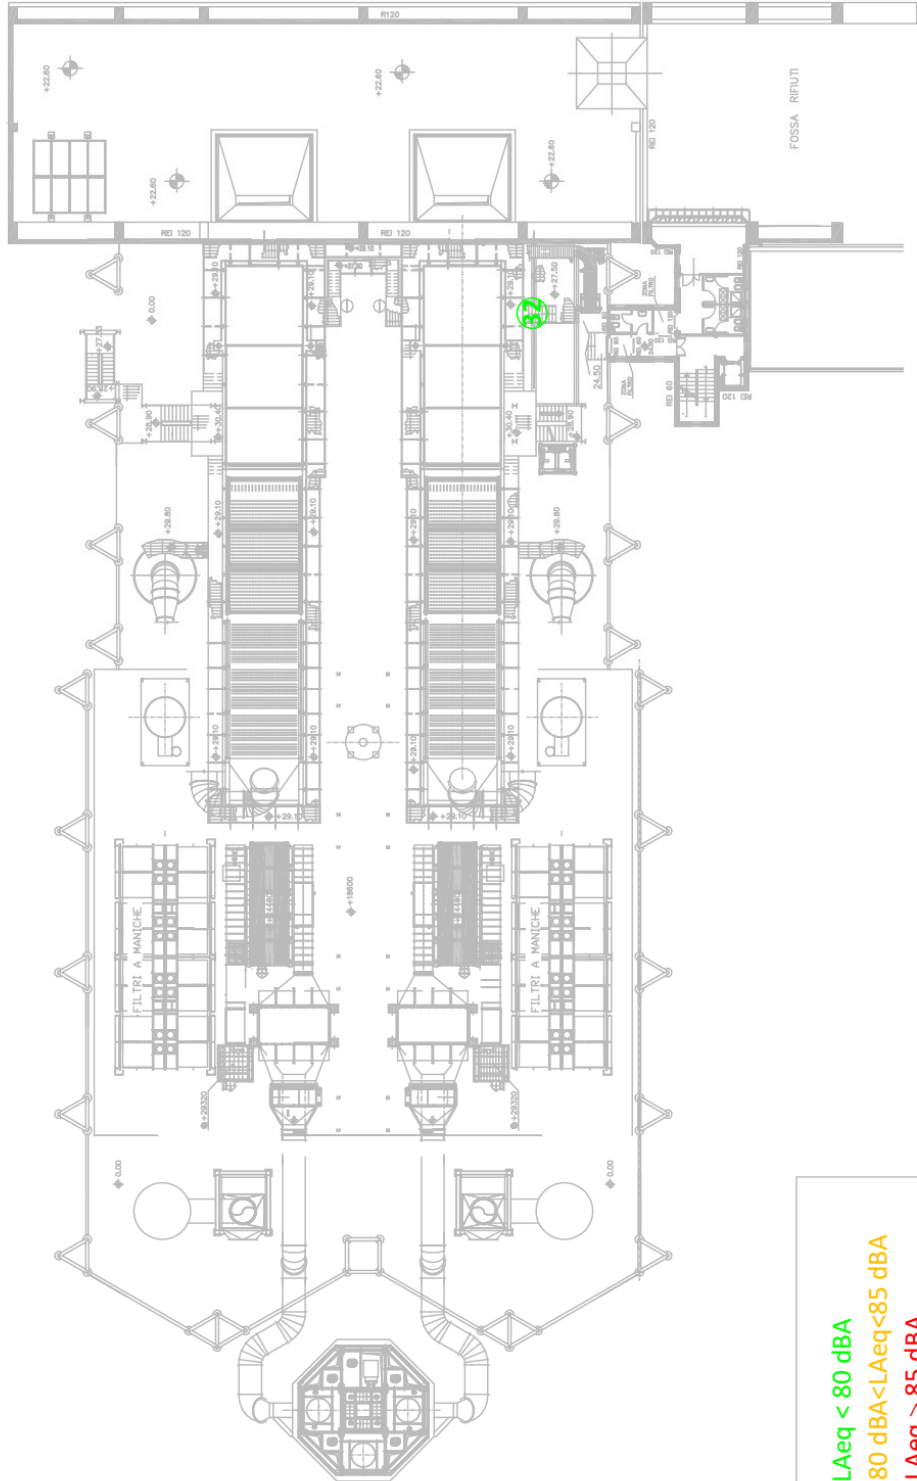

- ⊗ LAeq < 80 dBA
- ⊗ 80 dBA < LAeq < 85 dBA
- ⊗ LAeq > 85 dBA

IMPIANTO WTE : QUOTA +29,10

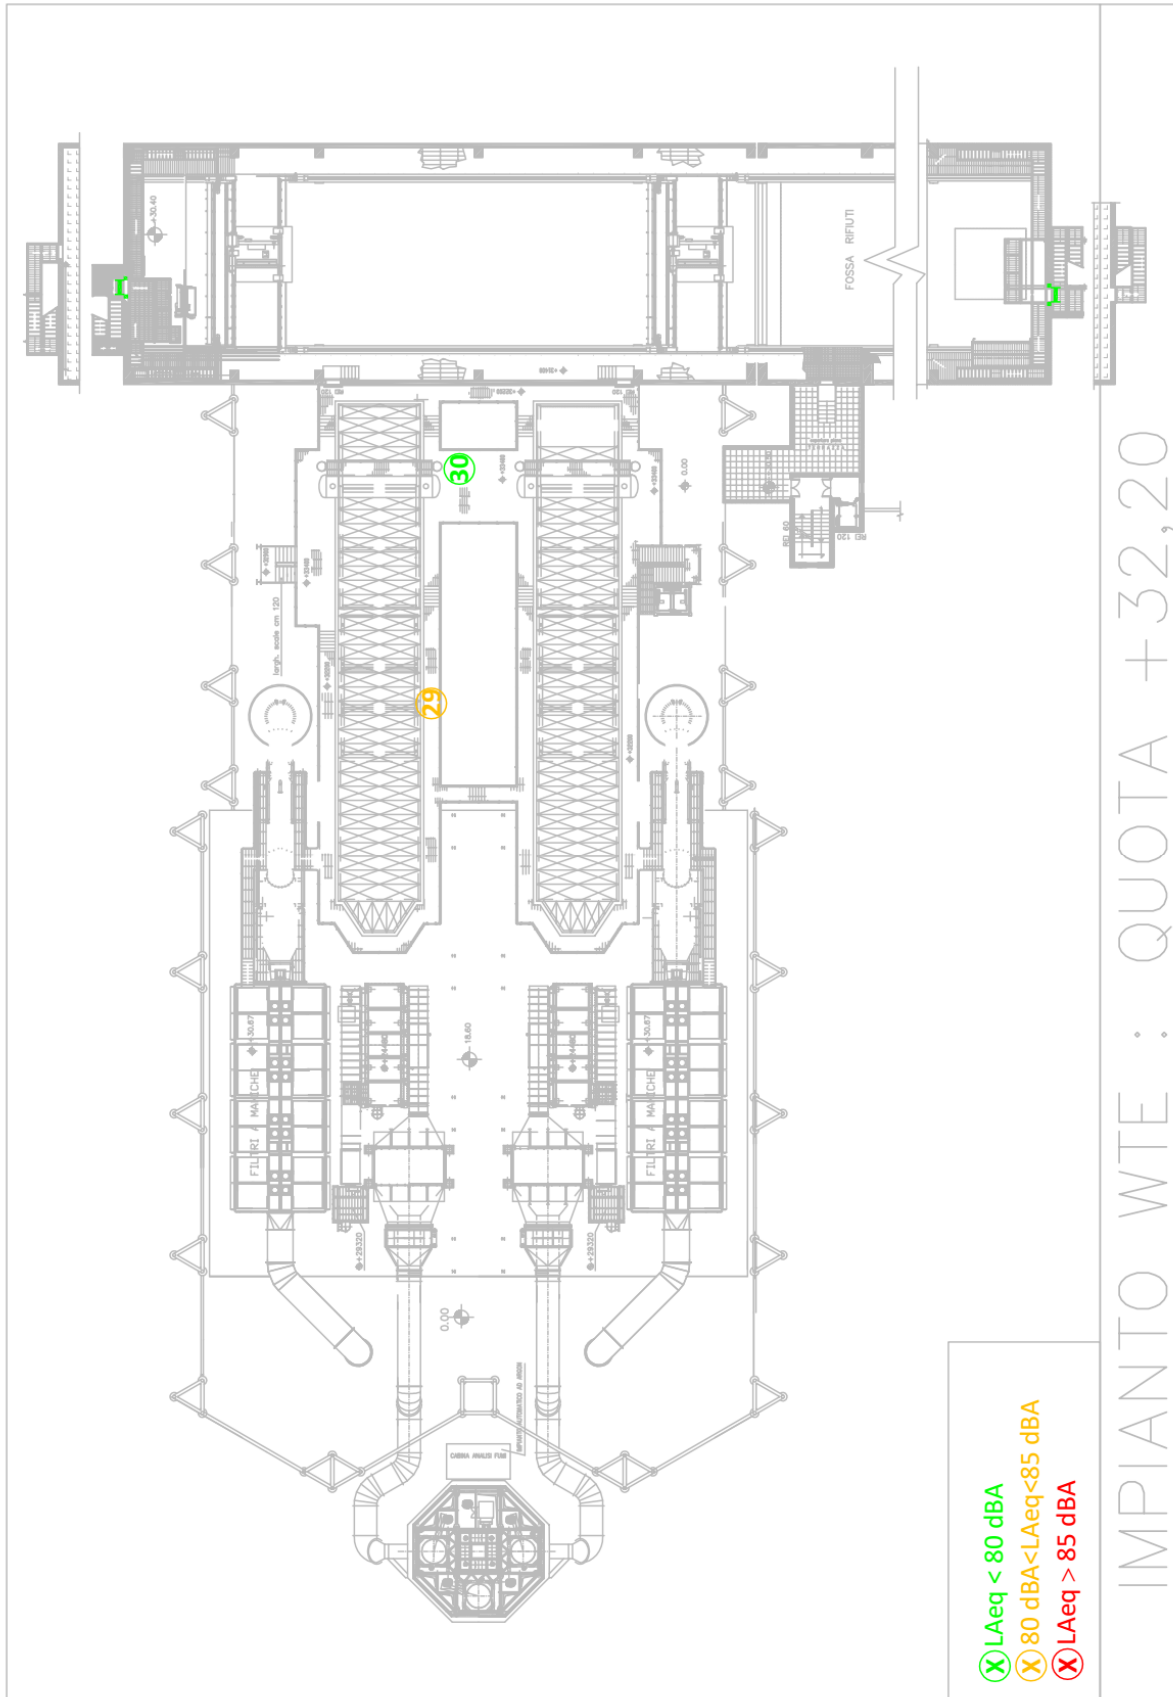

- ⊗ LAeq < 80 dBA
- ⊗ 80 dBA < LAeq < 85 dBA
- ⊗ LAeq > 85 dBA

IMPIANTO WTE : QUOTA +32,20

Torri di raffreddamento e ITAR

X LAeq < 80 dBA

X 80 dBA < LAeq < 85 dBA

X LAeq > 85 dBA

